


ALL NON-CURRENT CARRYING METALLIC PARTS TO BE BONDED  
TO NEUTRAL AND EFFECTIVELY GROUNDED  
BUILD PER NEC



NOTES:

1. COMMERCIAL TEMPORARY METERING SHALL FOLLOW THE COLD SEQUENCING GUIDELINES AND REQUIRE THE INSTALLATION OF FAULT LIMITING DISCONNECTS ON THE LINE SIDE OF THE METER. FUSE SIZE AND TYPE SHALL LIMIT THE FAULT CURRENT TO THE METER HOUSING TO BE 10,000 AMPS OR LESS.
2. CALL 1-800-922-1987 TO OBTAIN UTILITY LOCATES
3. MAINTAIN CLEARANCES FROM ALL UTILITIES

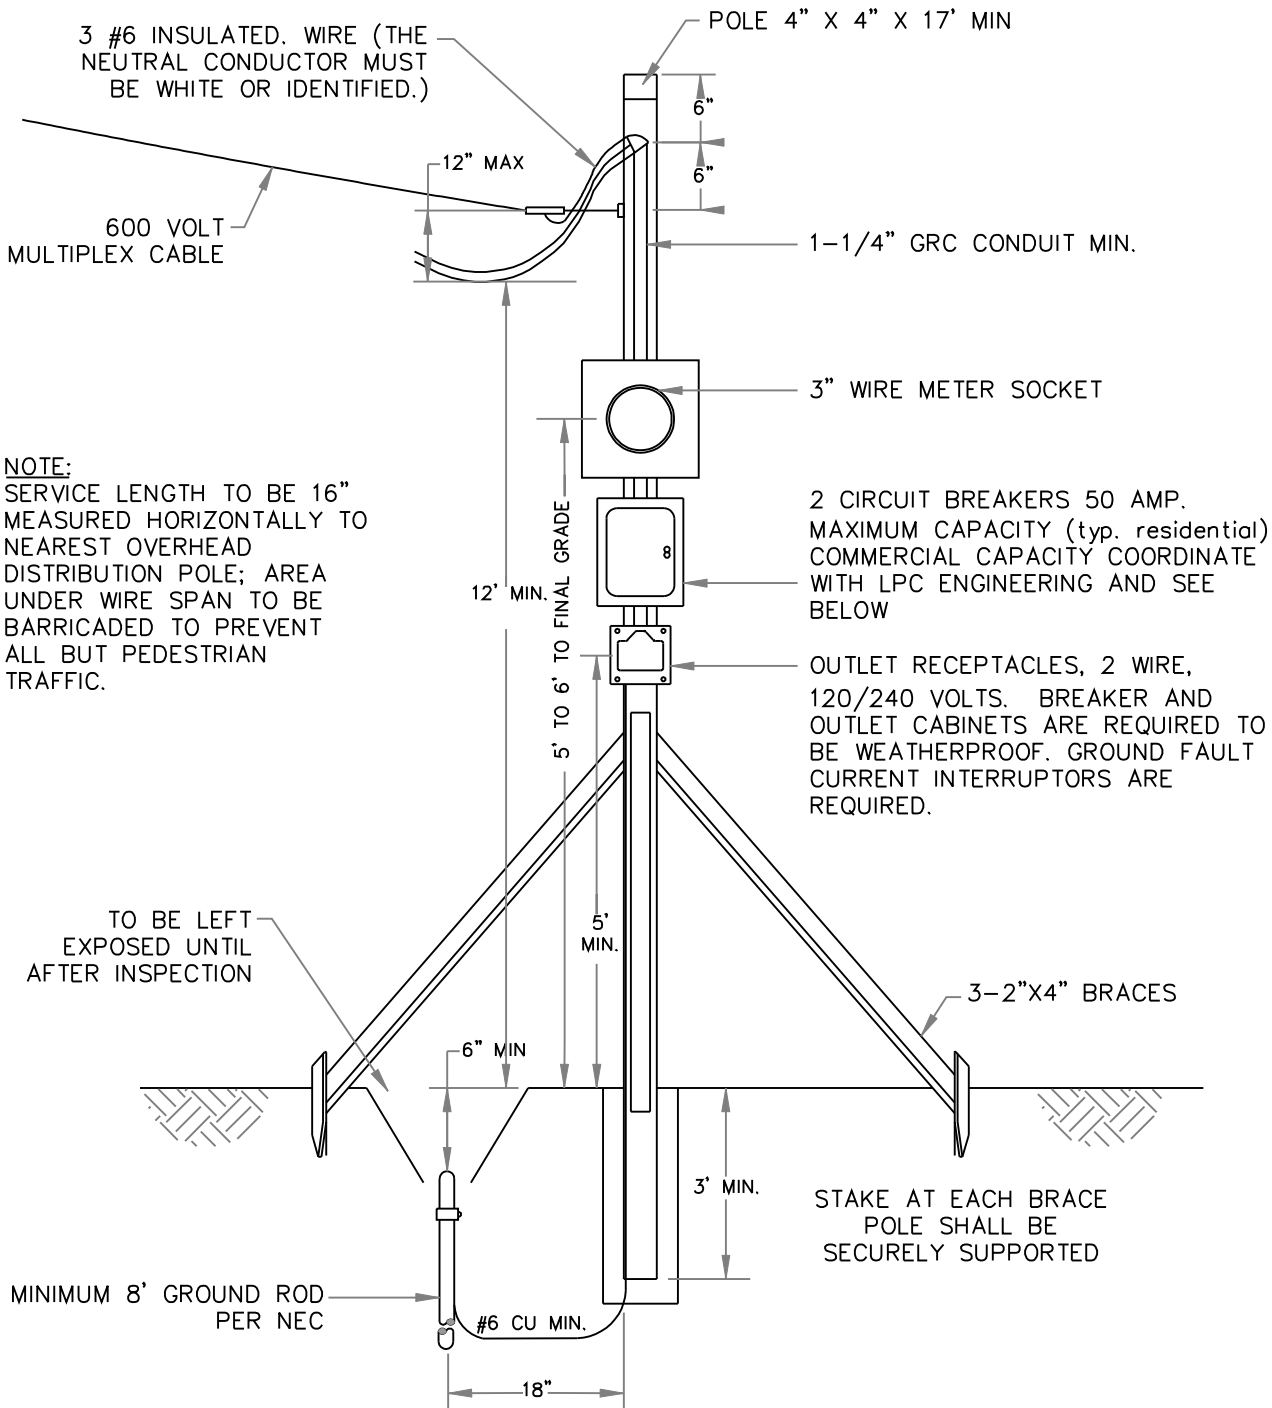

OVERHEAD TEMPORARY  
CONSTRUCTION METER POLE

REV 3

MTR-3

SCALE: Not to Scale

POWER & COMMUNICATIONS

DATE: 6/28/05

DRAWN BY: RAWTMF

APPROVAL: